


NOTES

1. PANEL SPECIFICATIONS: NEMA 4X ENCLOSURE
CONTROL SECTION
VOLTAGE: 24 VAC.
VALVE/LIGHT CIRCUIT: 120 VAC.

2. DASHED LINES REPRESENT FIELD WIRING REQUIRED
3. CONNECT GROUND TERMINAL IN BOX TO A GOOD GROUND

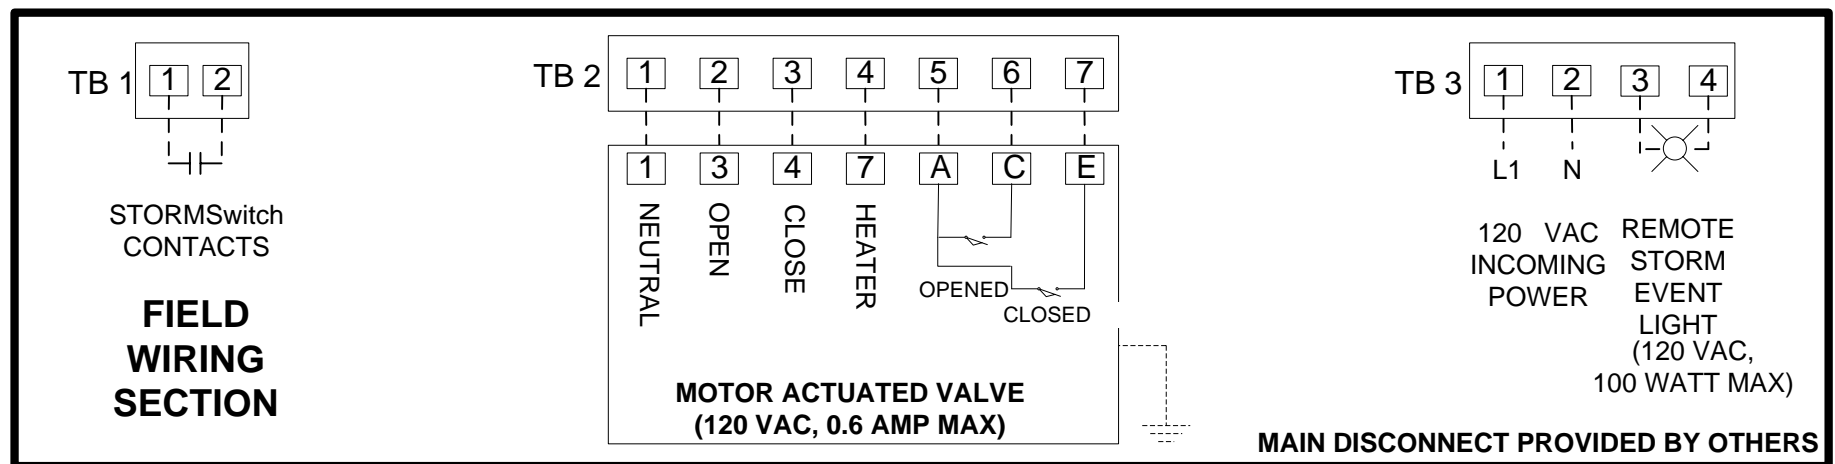

TEMPERATURE RATING OF FIELD INSTALLED CONDUCTORS MUST BE AT LEAST 140 DEG. F. (60 DEG. C.) FIELD WIRING TERMINALS AND GROUND LUGS WILL ACCEPT COPPER CONDUCTORS ONLY. TORQUE RATING OF FIELD WIRING TERMINAL CLAMPING SCREWS IS 7.1 – 8.9 IN/LBS FOR



(866) 283-8320

WWW.ATTITUDETECHNOLOGY.COM

ATTITUDE TECHNOLOGY, INC.

STORMController 212 w/Storm Event Light WIRING DIAGRAM for Hayward EMJ3

SIZE	DATE	DWG NO	REV
LTR	06-28-2008	PRO-000-233	
SCALE	NTS	DWNBY:DEM	SHEET 1 OF 1